

# Installation Manual

## ● Type : SDR DIN rail power supply

( Series : SDR-75, SDR-120, SDR-240, SDR-480, SDR-480P, SDR-960 )


SDR-75-12	INPUT: 100-240VAC 1.55A	50/60Hz	OUTPUT: 12V 6.3A
SDR-75-24	INPUT: 100-240VAC 1.55A	50/60Hz	OUTPUT: 24V 3.2A
SDR-75-48	INPUT: 100-240VAC 1.55A	50/60Hz	OUTPUT: 48V 1.6A
SDR-120-12	INPUT: 100-240VAC 1.4A	50/60Hz	OUTPUT: 12V 10A
SDR-120-24	INPUT: 100-240VAC 1.4A	50/60Hz	OUTPUT: 24V 5A
SDR-120-48	INPUT: 100-240VAC 1.4A	50/60Hz	OUTPUT: 48V 2.5A
SDR-240-24	INPUT: 100-240VAC 2.6A	50/60Hz	OUTPUT: 24V 10A
SDR-240-48	INPUT: 100-240VAC 2.6A	50/60Hz	OUTPUT: 48V 5A
SDR-480-24	INPUT: 100-240VAC 5A	50/60Hz	OUTPUT: 24V 20A
SDR-480-48	INPUT: 100-240VAC 5A	50/60Hz	OUTPUT: 48V 10A
SDR-480P-24	INPUT: 100-240VAC 5A	50/60Hz	OUTPUT: 24V 20A
SDR-480P-48	INPUT: 100-240VAC 5A	50/60Hz	OUTPUT: 48V 10A
SDR-960-24	INPUT: 200-240VAC 6A	50/60Hz	OUTPUT: 24V 40A
SDR-960-48 (Note.2)	INPUT: 200-240VAC 6A	50/60Hz	OUTPUT: 48V 20A

## ● Introduction

SDR is a DIN rail power supply series with a 150% peak load capability (3 seconds) and high efficiency of up to 94%. Like other Mean Well's DIN series, they can be mounted on a TS35 Standard DIN rail.

## ● Installation

- ( 1 ) Always allow good ventilation clearances, 5mm left and right, 40mm above and 20mm below, around the unit in use to prevent it from overheating.
- ( 2 ) The appropriate mounting orientation for the unit is vertical, the input terminals at the bottom and output on the top. Mounting orientations other than that, such as upside down, horizontal, or table-top mounting, is not allowed.

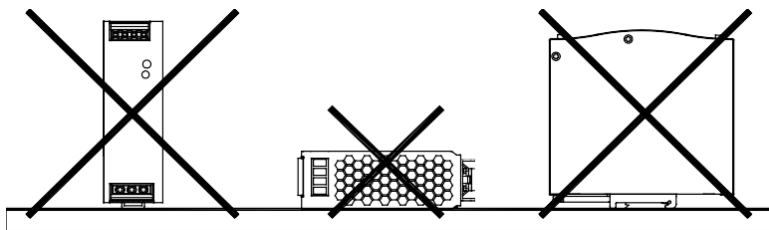

# Installation Manual

( 3 ) Use copper wire only, and recommended wires are shown as below.

AWG	18	16	14	12	10
Rated Current of Equipment (Amp)	6A	6-10A	13-16A	16-25A	25-32A
Cross-section of Lead(mm <sup>2</sup> )	0.75	1.00	1.5	2.5	4
Note: 1. Current each wire carries should be de-rated to 80% of the current suggested above when using 5 or more wires connected to the unit. 2. The maximum allowable wire cross-sectional area for the terminal of the SDR-75 is 12AWG/2.5 mm <sup>2</sup> .					

Make sure that all strands of each stranded wire enter the terminal connection and the screw terminals are securely fixed to prevent poor contact. If the power supply possesses multi-output terminals, please make sure each contact is connected to wires to prevent too much current stress on a single contact.

( 4 ) Use wires that can withstand temperatures of at least 80°C, such as UL1007.

( 5 ) Recommended wire strapping length is 5mm (0.197").

( 6 ) Recommended screwdriver is 4mm, slotted type.

( 7 ) The recommended torque setting for terminals is shown as below.

Model	I/P	O/P
SDR-75	6.9 kgf-cm (6 Lb-in)	6.9 kgf-cm (6 Lb-in)
SDR-120	10 kgf-cm (9 Lb-in)	10 kgf-cm (9 Lb-in)
SDR-240	10 kgf-cm (9 Lb-in)	10 kgf-cm (9 Lb-in)
SDR-480/480P	10 kgf-cm (9 Lb-in)	8 kgf-cm (7 Lb-in)
SDR-960	10 kgf-cm (9 Lb-in)	8 kgf-cm (7 Lb-in)

( 8 ) Suggested fuse and maximum number of the SDR PSUs that can be connected to a circuit breaker at 230V are shown as below.

Model	Fuse	Circuit breaker	
		C16	D16
SDR-75	T3.15A/L250V	10	12
SDR-120	T4A/L250V	7	14
SDR-240	T5A/L250V	4	8
SDR-480	T8A/L250V	4	4
SDR-480P	T8A/L250V	4	4
SDR-960	F10A/H250V	2	2

( 9 ) Mounting Instruction :


Mount as shown in figure only, with input terminals down, or else sufficient cooling will not be possible.

Admissible DIN rail : TS35/7.5 or TS35/15

For rail fastening :




- Tilt the unit slightly rearwards.
- Fit the unit over top hat rail.
- Slide it downward until it hits the stop.
- Press against the bottom for locking.
- Shake the unit slightly to check the locking action.

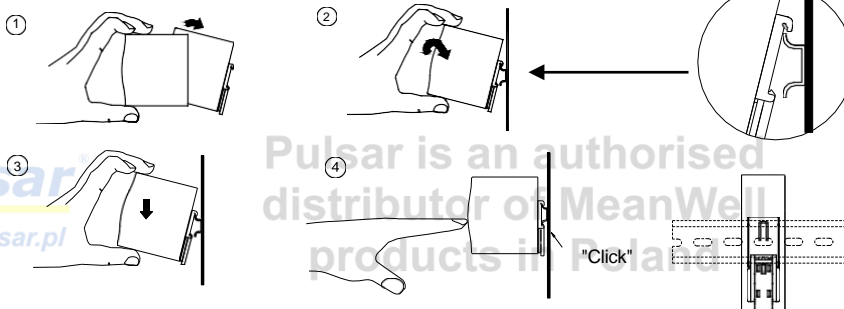

## Installation Manual

- ( 10 ) For SDR-960, if it is necessary for your system to meet EN61204-3 Radiation class B. Then, attaching a ferrite core clamp filter to the AC cable, as close as possible to the AC source, can fulfil the radiated emissions requirements. The wiring is shown below. There are compatible models including ZCAT2235-1030A by TDK, ZCAT12V-BK by TDK and KCF-130-B by KING CORE.

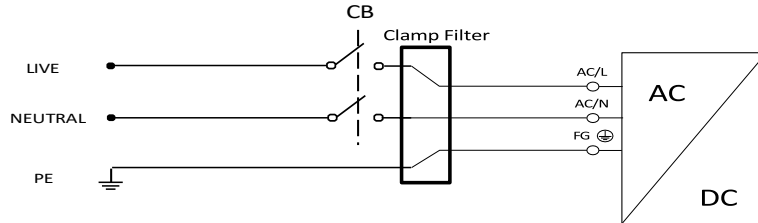

- ( 11 ) For other information about the products, please refer to [www.meanwell.com](http://www.meanwell.com) for details.

### Warning / Caution !!

- ( 1 ) Risk of electrical shock and energy hazard. All failure should be examined by a qualified technician. Please do not remove the case of the power supply by yourself!
- ( 2 ) Risk of electric arcs and electric shock (danger to life). Connecting both the primary and the secondary sides together is not allowed.
- ( 3 ) Risk of burn hazard. Do not touch the unit in operation and shortly after disconnection!
- ( 4 ) Risk of fire and short circuit. The openings should be protected from foreign objects or dripping liquids.
- ( 5 ) Only install the unit in a pollution degree 2 environment (Note.1).
- ( 6 ) Please do not install the unit in places with high moisture or near the water.
- ( 7 ) The maximum operating temperature is 50°C for SDR-960 series and 60°C for SDR-75/120/240/480/480P series, please do not install the unit in places with high ambient temperature or near fire source.
- ( 8 ) The FG (⏏) must be connected to PE (Protective Earth).
- ( 9 ) Output current and output wattage must not exceed the rated value on its specification.
- ( 10 ) SDR-960 is a class A product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.
- ( 11 ) Disconnect system from supply voltage:  
Before commencing any installation, maintenance or modification work: Disconnect your system from supply voltage. Make sure that inadvertent connection in circuit will be impossible!
- ( 12 ) For continued protection against risk of fire, replace only with same type and rating of fuse.  
Pour ne pas compromettre la protection contre les risques d'incendie, remplacer par un fusible de même type et de mêmes caractéristiques nominales.

Note.1: Pollution Degree 2 applies where there is only non-conductive pollution that might temporarily become conductive due to occasional condensation. Generally refer to dry, well-ventilated locations, such as control cabinets.

Note.2: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.



## Installation Manual

### Manufacturer :

MEAN WELL ENTERPRISES Co., LTD.  
No.28, Wuquan 3rd Rd., Wugu Dist.,  
New Taipei City 24891, Taiwan  
Tel: +886-2-2299-6100  
Web: [www.meanwell.com](http://www.meanwell.com)

### Branch Office :

#### **China**

MEAN WELL (GUANGZHOU)  
ENTERPRISES Co., LTD.  
No.11, Jingu South Road, Huadong  
Town, Huadu Distric, Guangzhou,  
Gungzhou, China  
Tel: +86-20-3773-7100  
Web: [www.meanwell.com.cn](http://www.meanwell.com.cn)

#### **China**

SUZHOU MEAN WELL  
TECHNOLOGY Co., LTD.  
No.269 Changping Rd. , Huangdai  
Town, Xiangcheng District  
Suzhou, Jiangsu Province, China  
Post Code: 215152  
Tel: +86-512-6508-8600  
Web: [www.meanwell.cc](http://www.meanwell.cc)

#### **U.S.A.**

MEAN WELL USA, INC.  
44030 Fremont Blvd., Fremont,  
CA 94538, U.S.A.  
Tel: +1-510-683-8886  
Web: [www.meanwellusa.com](http://www.meanwellusa.com)

#### **Europe**

MEAN WELL EUROPE B.V.  
Langs de Werf 8, 1185XT Amstelveen, The  
Netherlands  
Tel: +31-20-758-6000  
Web: [www.meanwell.eu](http://www.meanwell.eu)

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

2024.01.30

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

ISO-9001 CERTIFIED  
*Your Reliable Power Partner*



MEAN WELL ENTERPRISES CO., LTD.

No.28, Wuquan 3rd Rd., Wugu Dist., New Taipei City 24891, Taiwan (R.O.C.)

Tel: +886-2-2299-6100

Fax: +886-2-2299-6200

E-mail: info@meanwell.com

http://www.meanwell.com

## Declaration of China RoHS Conformity

In order to reduce the impacts on the environment and take the more responsibility for protecting the earth, MEAN WELL is confirming and announcing the conformity to China RoHS, an Administrative Measures for the Restriction of the Use of Hazardous Substances in Electrical and Electronic Products.

### Environment Friendly Use Period Label



Observing SJT 11364-2014, Marking for the Restricted Use of Hazardous Substances in Electronic and Electrical Products

Observing SJ/Z 11388-2009, General Guidelines of Environment-friendly Use Period of Electronic Information Products Appendix B, adopting table look-up to verify the Environment Friendly Use Period

### Names and Contents of Hazardous Substances Lists

Part Name	Hazardous Substances					
	Lead (Pb)	Mercury (Hg)	Cadmium (Cd)	Hexavalent chromium (Cr <sup>6+</sup> )	Polybrominated biphenyls (PBB)	Polybrominated diphenyl ethers (PBDE)
PCB and its components	X	O	O	O	O	O
Metal structure parts	X	O	O	O	O	O
Plastic structure parts	O	O	O	O	O	O
Accessories	O	O	O	O	O	O
Cables	X	O	O	O	O	O
O: The concentration of the hazardous substances within the homogeneous material of that product is less than the concentration limits set by GB/T 26572-2011. X: The concentration of the hazardous substances within the homogeneous material of that product is over the concentration limits set by GB/T 26572-2011; however, it follows the standard advised by 2011/65/EU.						

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

ISO-9001 CERTIFIED  
*Your Reliable Power Partner*



MEAN WELL ENTERPRISES CO., LTD.

No.28, Wuquan 3rd Rd., Wugu Dist., New Taipei City 24891, Taiwan (R.O.C.)

Tel: +886-2-2299-6100

Fax: +886-2-2299-6200

E-mail: info@meanwell.com

http://www.meanwell.com

## Declaration of China VOC Conformity

In order to reduce the impacts on the environment and take the more responsibility for protecting the earth, MEAN WELL is confirming and announcing the conformity to China's Standardization Administration Releases VOC Standards

Standard No.	Name of the Standard
GB 30981-2020	Limit of harmful substances of industrial protective coatings
GB 33372-2020	Limits for volatile organic compounds content in adhesive
GB 38507-2020	Limits for volatile organic compounds (VOCs) In printing ink
GB 38508-2020	Limits for volatile organic compounds content in cleaning agents





MEAN WELL ENTERPRISES CO., LTD.

No.28, Wuquan 3rd Rd., Wugu Dist., New Taipei City 24891, Taiwan (R.O.C.)

Tel: +886-2-2299-6100

Fax: +886-2-2299-6200

E-mail: info@meanwell.com

http://www.meanwell.com

## Declaration of Five PBT TSCA Conformity

In order to reduce the impacts on the environment and take the more responsibility for protecting the earth, MEAN WELL hereby confirms that MEAN WELL product series comply with Use and Risk Management for Five PBT Chemicals under TSCA section 6(h)

CAS No.	Substance Name
1163-19-5	Decabromodiphenyl ether (DecaBDE)
68937-41-7	Phenol, isopropylated, phosphate (3:1) PIP (3:1)
732-26-3	2,4,6-Tris (tert-butyl) phenol (2,4,6-TTBP)
133-49-3	Pentachlorothiophenol (PCTP)
87-68-3	Hexachlorobutadiene (HCBd)

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland

Pulsar is an authorised  
distributor of MeanWell  
products in Poland



ISO-9001 CERTIFIED  
*Your Reliable Power Partner*